


MAPTrix™ Screen, ECM Mimetic Plate (ANN901)

- Surface presenting ECM derived peptide motifs derived from collagen, fibronectin, and laminin

ARRAY MAP

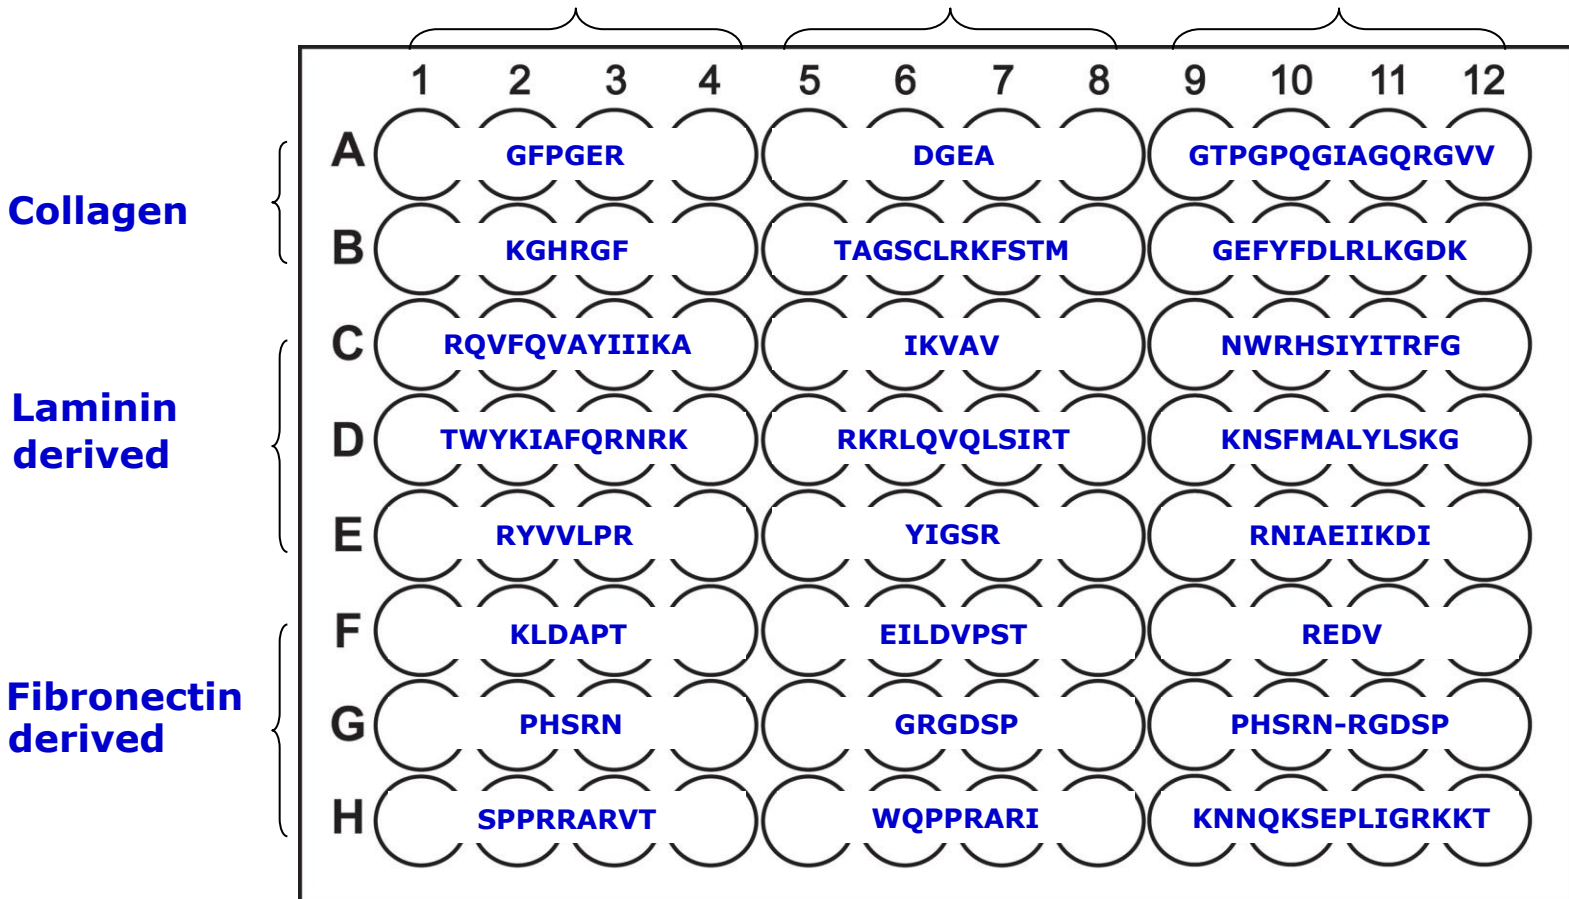

Map updated and corrected April 2021

STORAGE

Stable & functional for 2 years when stored at room temperature and refrigerator.

ORDERING DETAILS

Code	Description	Pack
ANN901	MAPTrix™ Screen for Cell Adhesion Assay, 24 different ECM mimetics coated 96 well plate (4 duplicates), 2 plates	2 plates per case

AMSBIO | www.amsbio.com | info@amsbio.com

 **UK & Rest of the World**
 184 Park Drive, Milton Park
 Abingdon OX14 4SE, U.K.
 T: +44 (0) 1235 828 200
 F: +44 (0) 1235 820 482

 **North America**
 1035 Cambridge Street,
 Cambridge, MA 02141.
 T: +1 (617) 945-5033 or
 T: +1 (800) 987-0985
 F: +1 (617) 945-8218

 **Germany**
 Bockenheimer Landstr. 17/19
 60325 Frankfurt/Main
 T: +49 (0) 69 779099
 F: +49 (0) 69 13376880

 **Switzerland**
 Via Lisano 3
 (CP.683)
 6900 Massagno
 T: +41 (0) 91 604 55 22
 F: +41 (0) 91 605 17 85

ASSAY PROCEDURE

1. Introduction

Cell adhesion is a complex process involved in embryogenesis, migration/invasion, tissue remodeling, and wound healing. To perform these processes, cells adhere to extracellular matrix components via adhesion receptors such as integrins, forming complexes with components of the cytoskeleton that ultimately affect cell motility, differentiation, proliferation, and survival. MAPTrix™ Screen provides a rapid, quantitative method for evaluating cell adhesion.

2. Cell Adhesion Assay Protocol (For 96 well plate)

1. Under sterile conditions, re-hydrate the MAPTrix Screen plate with 200 µL of PBS (1x) per well for 20 minutes at room temperature.
2. Remove the PBS from the rehydrated plates
3. Prepare a cell suspension, typically, 0.1 - 2.0 x 10⁶ cells/mL in serum free media.
4. Add 150 µL of the cell suspension to the inside of each well and centrifuged to promote interaction with the plate surface.
5. Non-adherent cells are gently removed with 3 times PBS washes. The percentage of adherent cells is determined by measuring Calcein AM fluorescence before and after the wash steps.

AMSBIO | www.amsbio.com | info@amsbio.com



UK & Rest of the World
184 Park Drive, Milton Park
Abingdon OX14 4SE, U.K.
T: +44 (0) 1235 828 200
F: +44 (0) 1235 820 482



North America
1035 Cambridge Street,
Cambridge, MA 02141.
T: +1 (617) 945-5033 or
T: +1 (800) 987-0985
F: +1 (617) 945-8218



Germany
Bockenheimer Landstr. 17/19
60325 Frankfurt/Main
T: +49 (0) 69 779099
F: +49 (0) 69 13376880



Switzerland
Via Lisano 3
(CP.683)
6900 Massagno
T: +41 (0) 91 604 55 22
F: +41 (0) 91 605 17 85